

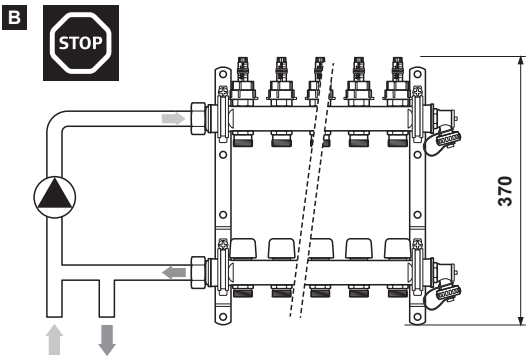


Uponor

Uponor Vario S Manifold FM

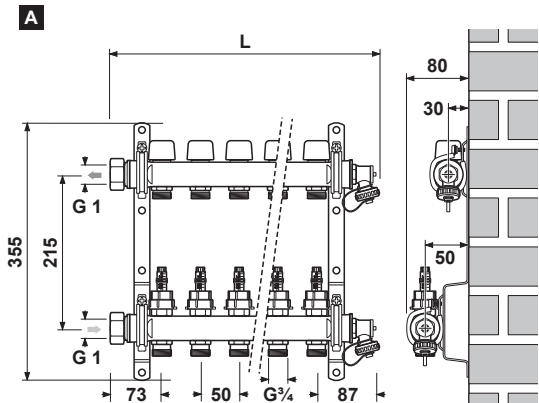

n	L [mm]	n	L [mm]	n	L [mm]
2	210	7	460	12	710
3	260	8	510	13	760
4	310	9	560	14	810
5	360	10	610	15	860
6	410	11	660	16	910



$\vartheta_{sec} = 15 - 60^{\circ}C$



$P_{max} = 6 \text{ bar}$



$P_{test} = 10 \text{ bar}$







$kvs = 1,1 \text{ m}^3/h$







$kvs = 3,1 \text{ m}^3/h$



$\dot{V}_{max} = 3,6 \text{ m}^3/h \text{ (12 loops)}$


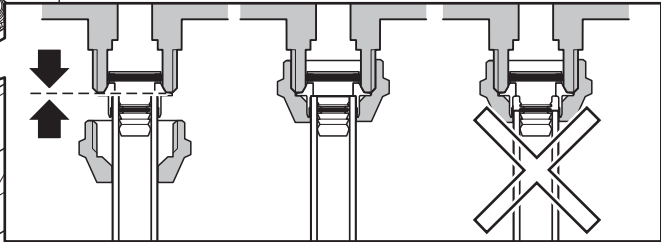
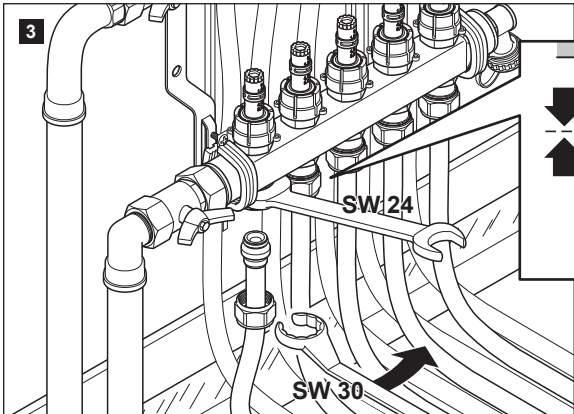
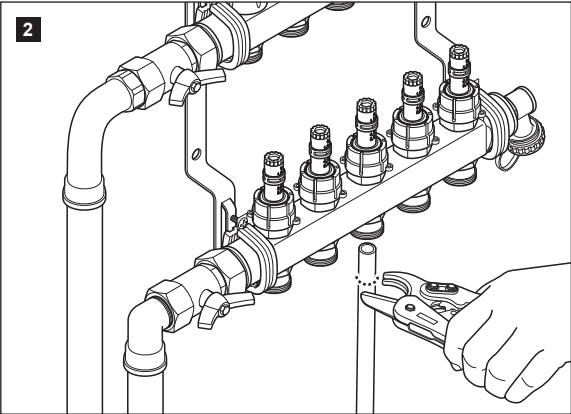
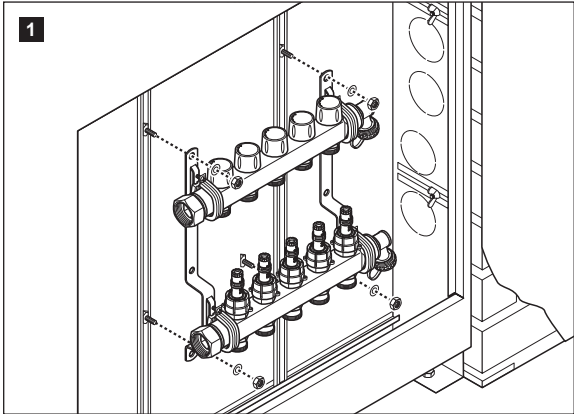


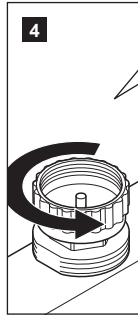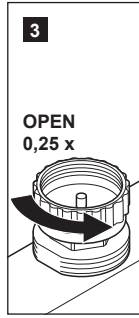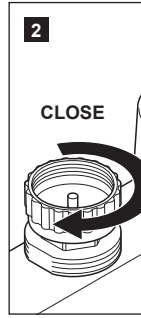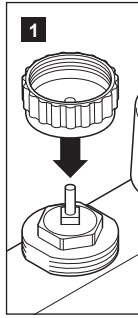

1,5 L/min

Uponor floor heating calculations
 Uponor Fuilbodemwarmingberekening
 Uponor vloerwarmingberekening
 Calculations de chauffage par le sol Uponor
 Calcolo riscaldamento a pannelli Uponor

Room heating circuit data		Room heating circuit data	
Room No.	Room Name	Room No.	Room Name
1	1	2	0,5
1	2	5	3
2	3	2	1
3	4	4	4
4	5	1,5	2

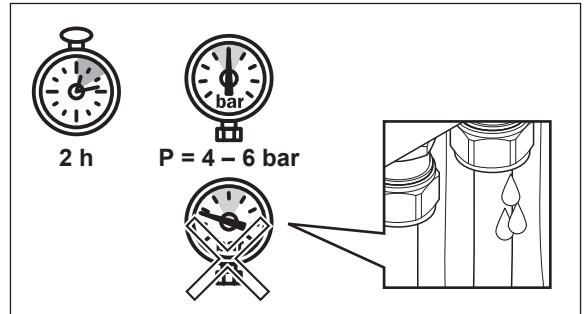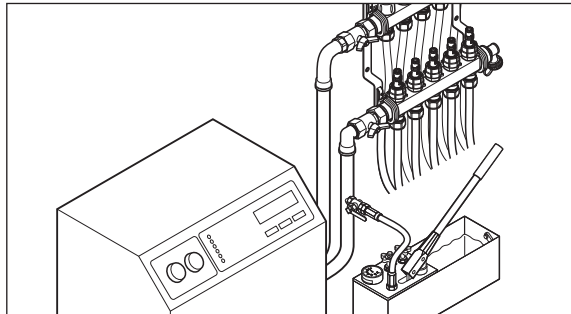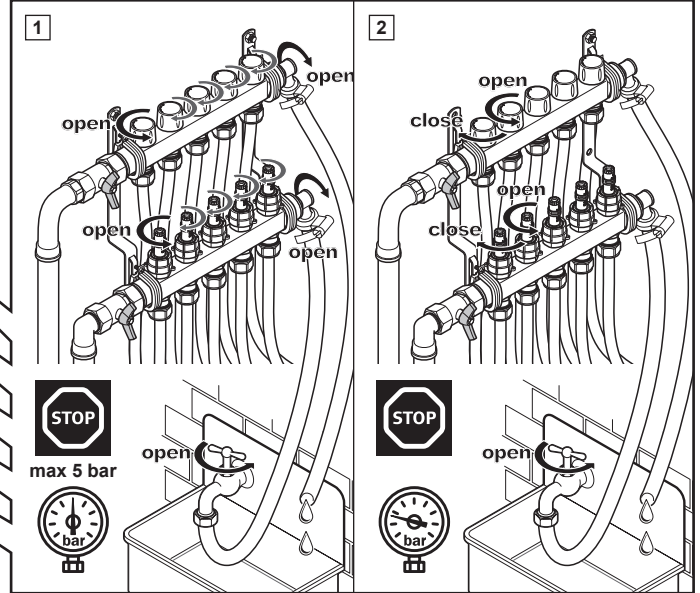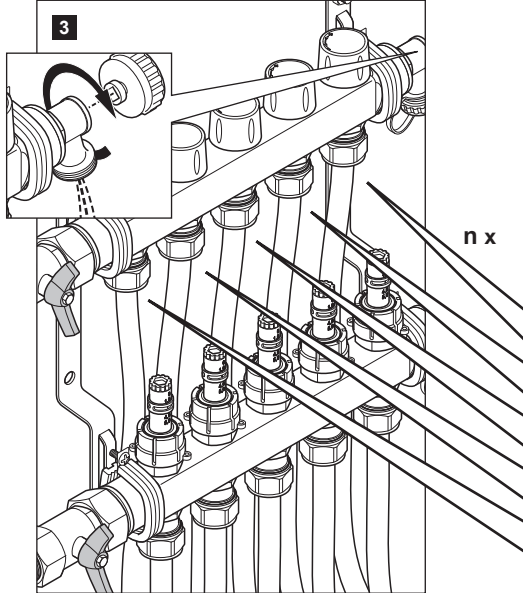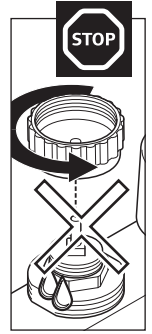

Uponor GmbH
 Industriestraße 56,
 D-97437 Hassfurt, Germany

1087620 11_2020 INT
 Production: Uponor / ELO

Uponor reserves the right to make changes, without prior notification, to the specification of incorporated components in line with its policy of continuous improvement and development.



www.uponor.com