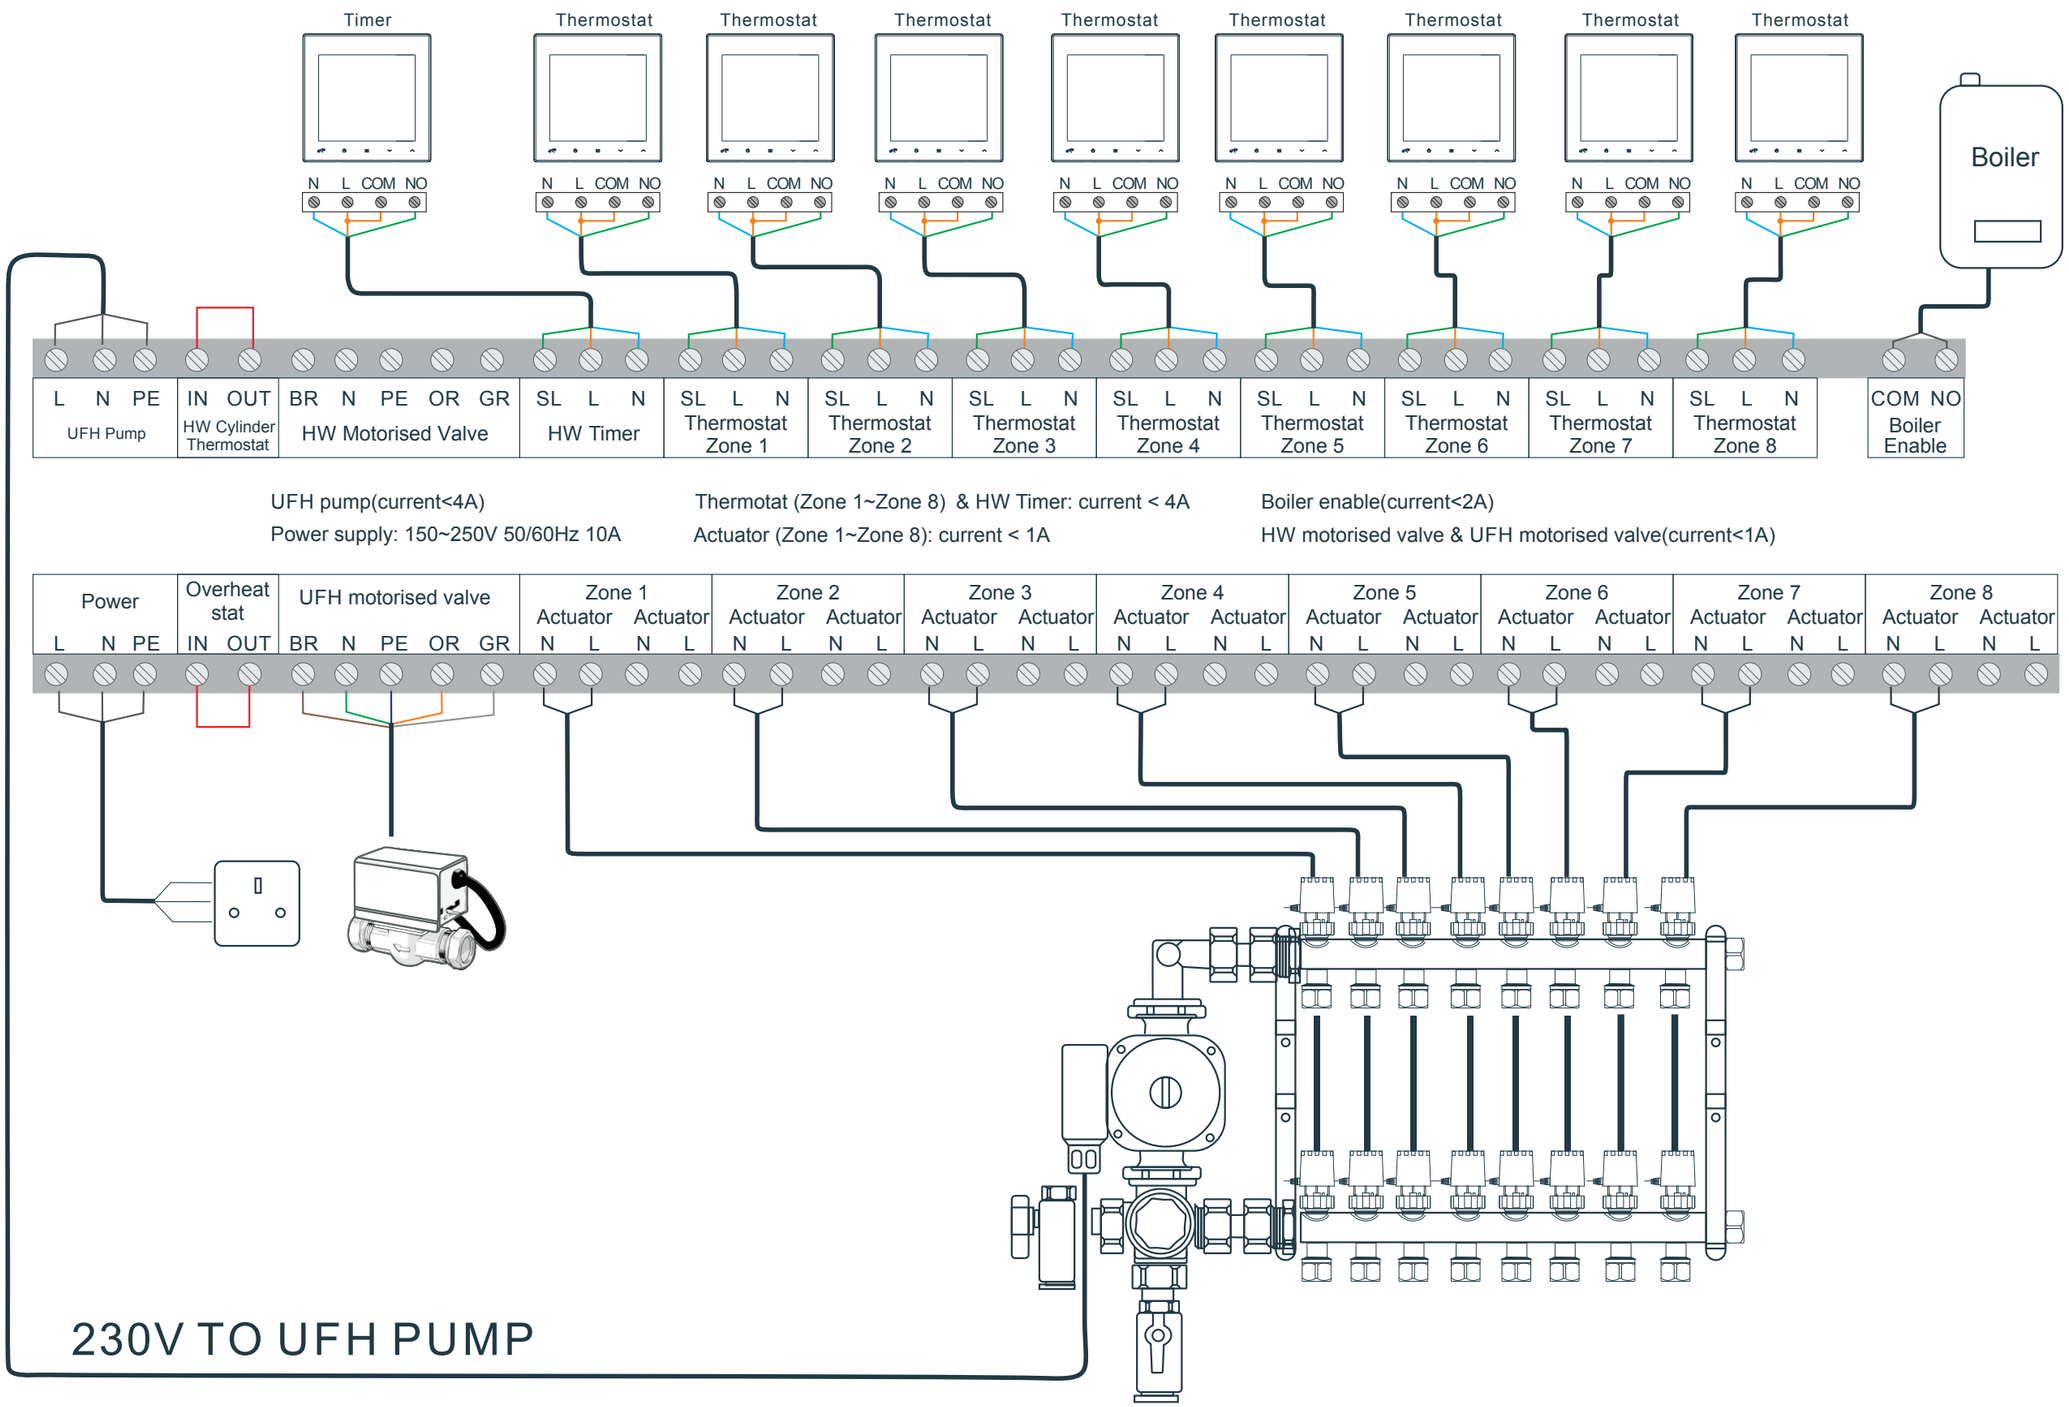
Timer
Thermostat
N L COM NO
Boiler
L N PE
UFH Pump
IN OUT
HW Cylinder Thermostat
BR N PE OR GR
HW Motorised Valve
SL L N
HW Timer
Thermostat Zone 1
Thermostat Zone 2
Thermostat Zone 3
Thermostat Zone 4
Thermostat Zone 5
Thermostat Zone 6
Thermostat Zone 7
Thermostat Zone 8
COM NO
Boiler Enable
UFH pump(current<4A)
Power supply: 150~250V 50/60Hz 10A
Thermotat (Zone 1~Zone 8) & HW Timer: current < 4A
Actuator (Zone 1~Zone 8): current < 1A
Boiler enable(current<2A)
HW motorised valve & UFH motorised valve(current<1A)
Power
Overheat stat
UFH motorised valve
Zone 1
Zone 2
Zone 3
Zone 4
Zone 5
Zone 6
Zone 7
Zone 8
Actuator
230V TO UFH PUMP